

Andy Schreder CBO Email: andy@rumrivercc.com Cell: 763-291-3704

ATHENS TOWNSHIP ROOF PERMIT APPLICATION

NOTICE: THIS IS AN APPLICATION ONLY. PERMIT WILL BE ISSUED AFTER APPROVAL AND PAYMENT OF FEES. WORK IS NOT AUTHORIZED TO BEGIN PRIOR TO ISSUANCE. ~ SUBMIT APPLICATION TO: RUM RIVER CONSTRUCTION CONSULTANTS AT EMAIL ADDRESS ABOVE.

APPLICANT IS THE: OWNER CONTRACTOR

SITE ADDRESS: _____

PROPERTY OWNER NAME _____

ADDRESS _____ CITY _____ STATE/ZIP _____

PHONE # _____ EMAIL _____

CONTRACTOR NAME _____

ADDRESS _____ CITY _____ STATE/ZIP _____

PHONE # _____ EMAIL _____

CONTRACTOR STATE LICENSE #: _____

LEAD CERTIFIED FIRM #: _____

CONTACT NAME: _____ PHONE: _____

DESCRIPTION OF WORK: _____

VALUATION (LABOR & MATERIALS): \$ _____

The undersigned acknowledges that he/she has read this application and the above information is correct and accurate. Applicant also understands by signing this application that he/she could be held responsible as representative of this project for any violation of compliance with all applicable laws and ordinances of the ruling jurisdiction.

APPLICANT SIGNATURE _____ PRINTED NAME _____

DATE _____

OFFICE USE ONLY

DATE PAID _____ PAYMENT INFO _____ RECEIVED BY _____

ENGINEERING _____ DATE _____ ENGINEERING FEE: \$ _____

PLANNING _____ DATE _____ ZONING FEE: \$ _____

BUILDING _____ DATE _____ PLAN REVIEW FEE: \$ _____

PERMIT FEE: \$ _____

SURCHARGE FEE: \$ _____

TOTAL FEES: \$ _____



Andy Schreder CBO Email: andy@rumrivercc.com Cell: 763-291-3704

ROOFING

INSTALLATION INFORMATION

Scope

The scope of this handout will be limited to Residential Asphalt, Fiberglass and Metal Roofing Panels. For other materials or commercial roofing projects, please contact a member of the Building Department Staff.

Permits and Licenses

A Building Permit is required for all roofing projects beyond simple repairs. Contact the Building Official with questions about what constitutes a repair. All contractors engaged in roofing work must have a state contractor's license and show proof to obtain the permit. Specific questions regarding contractor licenses should be directed to the Minnesota Department of Labor and Industry at (651) 284-5069

Existing Roofs

Roof structures and material manufactures typically have not allowed roof overlays of multiple layers. Consequently, all projects must begin by removing the existing roof system. Roof decks shall be made to accept the new layer of roofing in accordance with the chosen roofing manufacturer.

Required Inspections

(Please allow at least 2 business days for all inspection requests.)

Roof replacements require 2 inspections: 1) ICE & WATER and 2) FINAL INSPECTION.

1. Verification of the underlayment material and location (ice and water) by either a SITE inspection OR photos.
 - a. If you choose to provide photos to take the place of a site inspection, please see the following instructions to ensure code provisions can be verified:
 - i. The first picture to be taken needs to be of the front of the house showing the house number.
After this initial picture:
 - ii. At least two pictures need to be taken of every side or elevation showing the proper distance has been covered.
 - iii. Photos must be submitted and approved prior to scheduling a final inspection.
 - iv. If you are not able to submit photos electronically, they must be mailed in and approved prior to calling for final roof inspection.
 - v. Final inspections will not be done unless the ice/water inspection has been done or photos have been approved.
2. A final inspection.

Valley Underlayment


Valley linings shall be installed per the manufacture's requirements and chapter 9 of the Minnesota State Residential Code.

Valley Flashing

When existing flashing is no longer serviceable, it shall be replaced. Valley flashing shall consist of not less than 26-Gauge galvanized sheet metal or other code approved valley lining material. The flashing shall extend at least 12 inches from the center line each way. Sections of flashing shall have an end lap of not less than four inches. Alternately, the valley may consist of woven shingles or closed-cut style applied in accordance with the manufacturer's instructions

Fasteners/Wind Rating

Fastener type and spacing shall be in conformance with manufacturer requirements. Wind rating and fastening schedule will be verified on site prior to final approval.

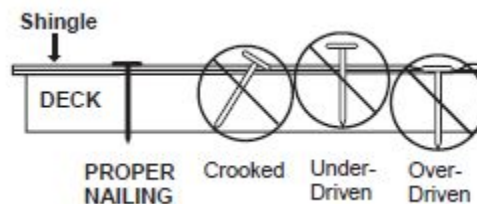

Roof Pitch

Asphalt shingles shall not be installed on roofs with less than a 2:12 pitch and require special application procedures for less than 4:12 pitch. Manufacture instructions supersede all other requirements.

Ventilation

Ventilation of enclosed attics and enclosed rafter spaces is required. Ventilation openings must be provided with corrosion-resistant mesh with openings between 1/8" to 1/4". If necessary, additional roof and soffit vents must be installed so that for every 300 square feet of attic area there is at least 1 square foot of ventilation. At least 50 percent but not more than 80 percent, shall be in the upper portion of the roof.

Exhaust Vents

Care should be taken to ensure that kitchen and bathroom exhaust fan ducts are connected to the correct roof termination with no openings into the attic. The exhaust vents shall be installed the same as other attic vents and vent pipe flashings. When re-roofing around furnace flues, take care not to dislodge the joints of the flue pipe within the attic or within interior chases which the pipe may pass through. If in doubt, consult a licensed mechanical contractor.

Roof Edging, Gutters, Drainage


Roof edging and gutters are not mandated by Code. Application of roof edging must be in accordance with the shingle manufacturers written instructions. Gutters may be useful in directing water away from buildings reducing erosion, settlement and wet basements. Extensions on downspouts should extend far enough from the building to result in positive drainage.

Debris


Roofing projects often result in debris moving about the neighborhood on windy days. Shingle wrappers and other construction debris are nuisances to neighbors when they find this material in their yards. As you install a new roof on your home, we ask that you exercise courtesy towards your neighbors by regularly policing your yard and adjoining areas. Thank you.

Ice and Water Barrier

An *Ice Barrier* in compliance with R905 is required on all roofs except unheated detached accessory buildings. The barrier may be two layers of underlayment cemented together or a self-adhering polymer modified bitumen sheet. There are several manufactures that make materials specifically for this requirement marketed under differing trade names. The Ice Barrier must extend from the edge of the eaves to a point 24 inches inside the exterior wall line of the building.

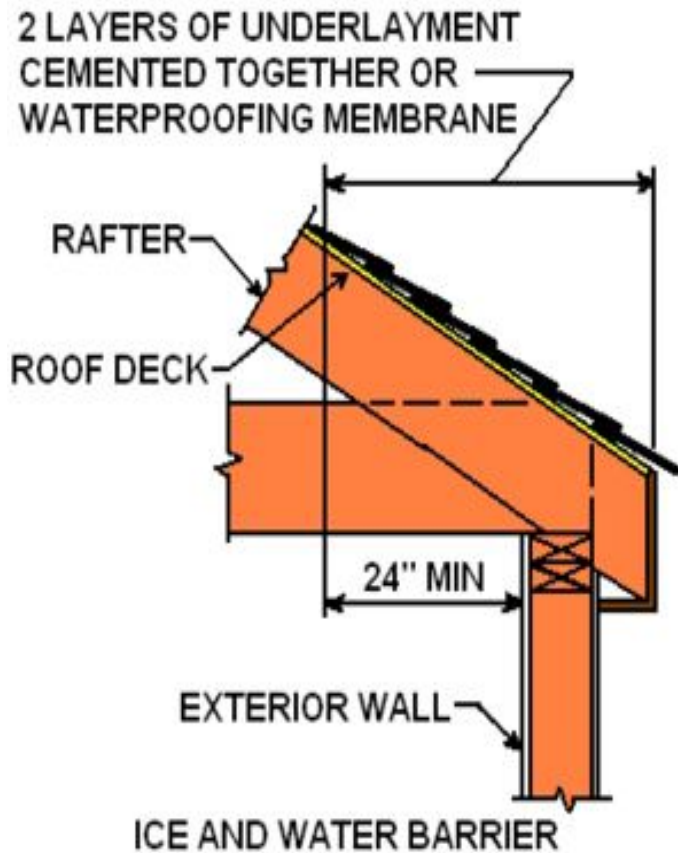


Where to use ice protection

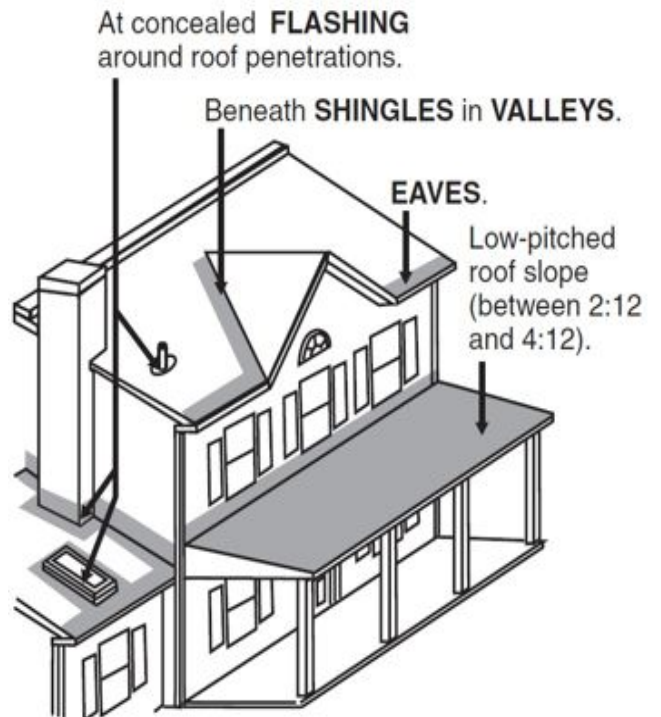

Vertical Wall Flashing

Apply shingles up the roof until a course must be trimmed to fit at the base of the vertical wall. Plan to adjust the exposure slightly (and evenly) in the previous courses, so that the last shingle is at least 8 inches wide (vertically). This allows a minimum 5-inch exposure of the top course and a 3-inch head lap.


The flashing strip should be bent, using a metal brake, to extend at least 2 inches up the vertical wall and at least 3 inches onto the last shingle course, that is, to the top of the cutout. Water resistive barrier **MUST** extend over the top of the flashing.

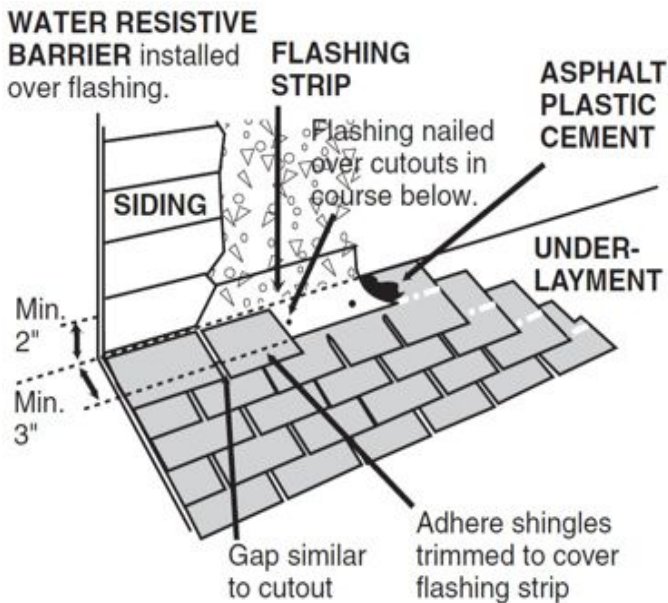


Shingle application around flashing

Top and sides: **SHINGLES** overlap flange and are set in asphalt plastic cement.

Bottom: **FLANGE** overlaps shingles.

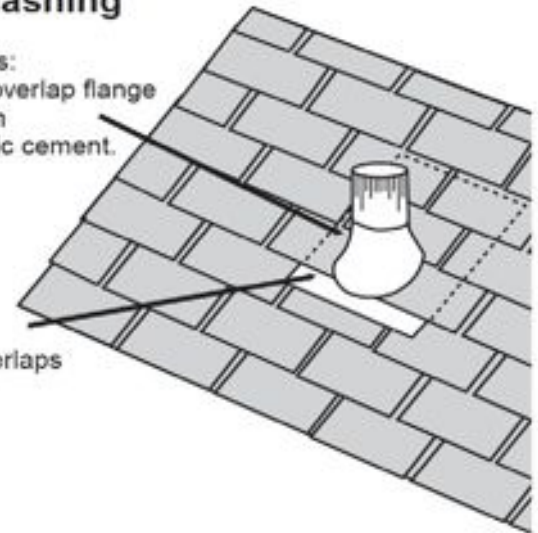

Sidewall flashing (26-Gauge)

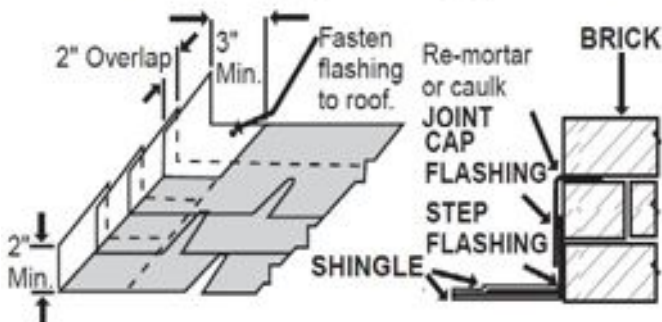

Kick-out flashing

WATER RESISTIVE BARRIER/HOUSEWRAP
Place over Step Flashing.

